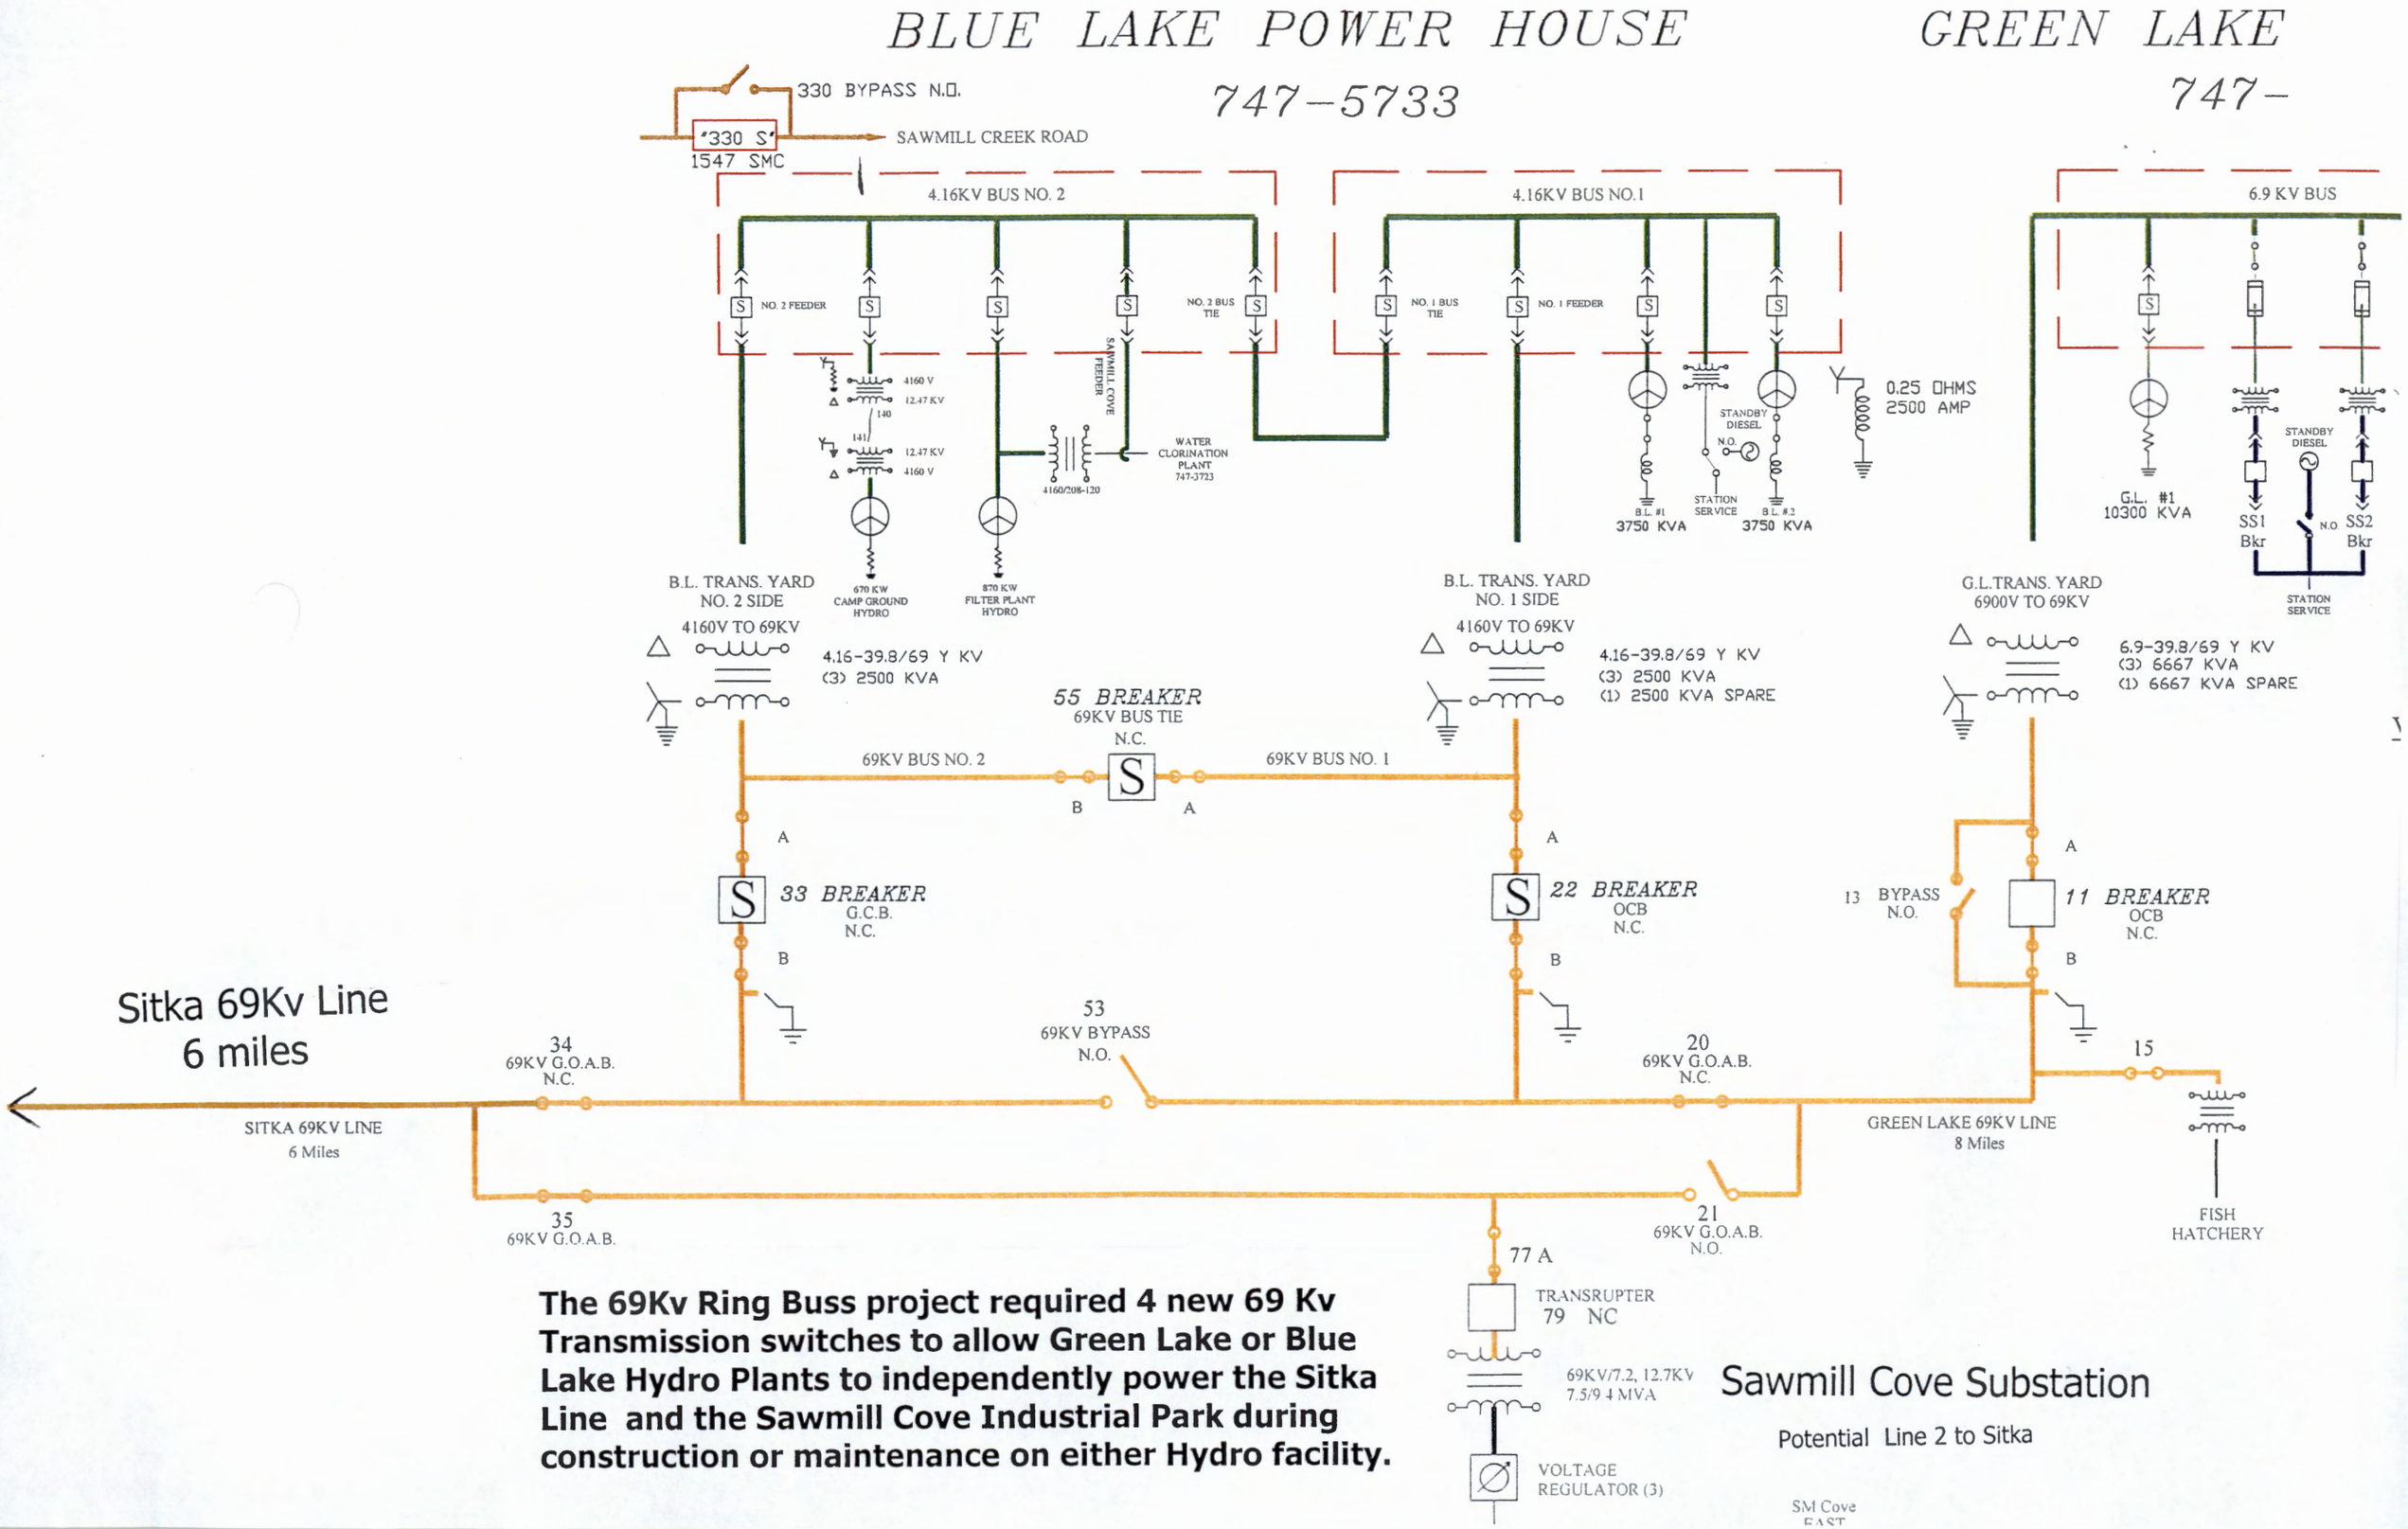

The 69Kv Ring Buss project required 4 new 69 Kv Transmission switches to allow Green Lake or Blue Lake Hydro Plants to independently power the Sitka Line and the Sawmill Cove Industrial Park during construction or maintenance on either Hydro facility.